


Plot Scale - 1:200

Plotted From - TRRC12608

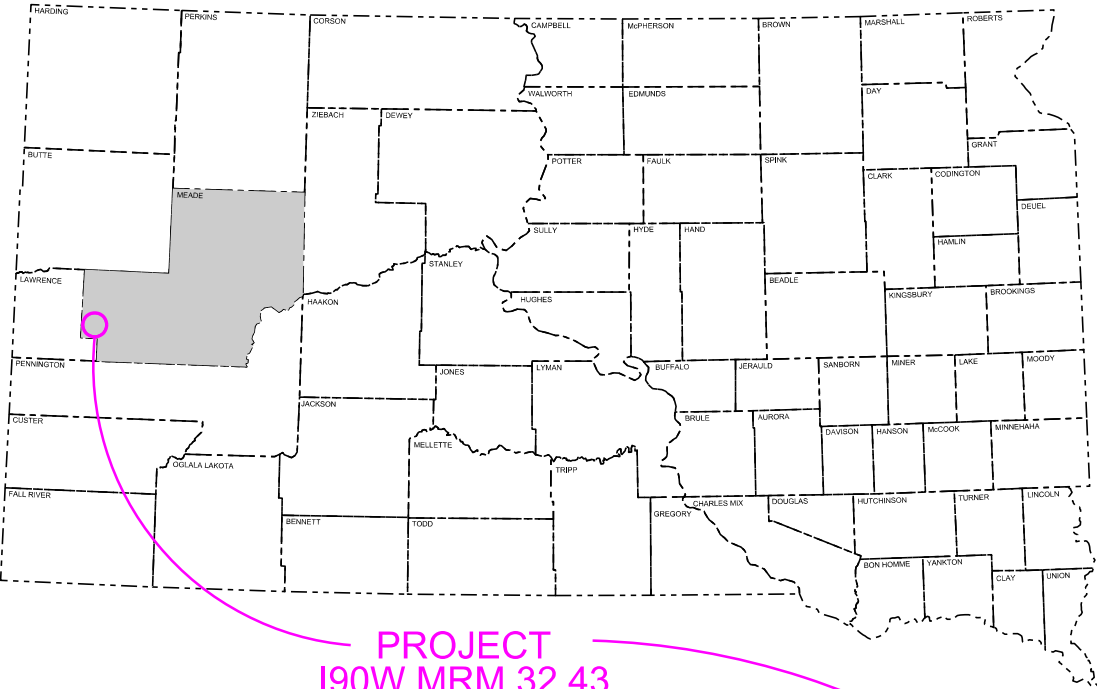

PROJECT
I90W MRM 32.43
EXIT 32 WB OFF RAMP


STATE OF SOUTH DAKOTA
DEPARTMENT OF TRANSPORTATION
PLANS FOR PROPOSED

PROJECT 090 W-451
I90 EXIT 32
MEADE COUNTY

CURB AND GUTTER & EROSION CONTROL
PCN i6ym

R 5 E

T 5 N

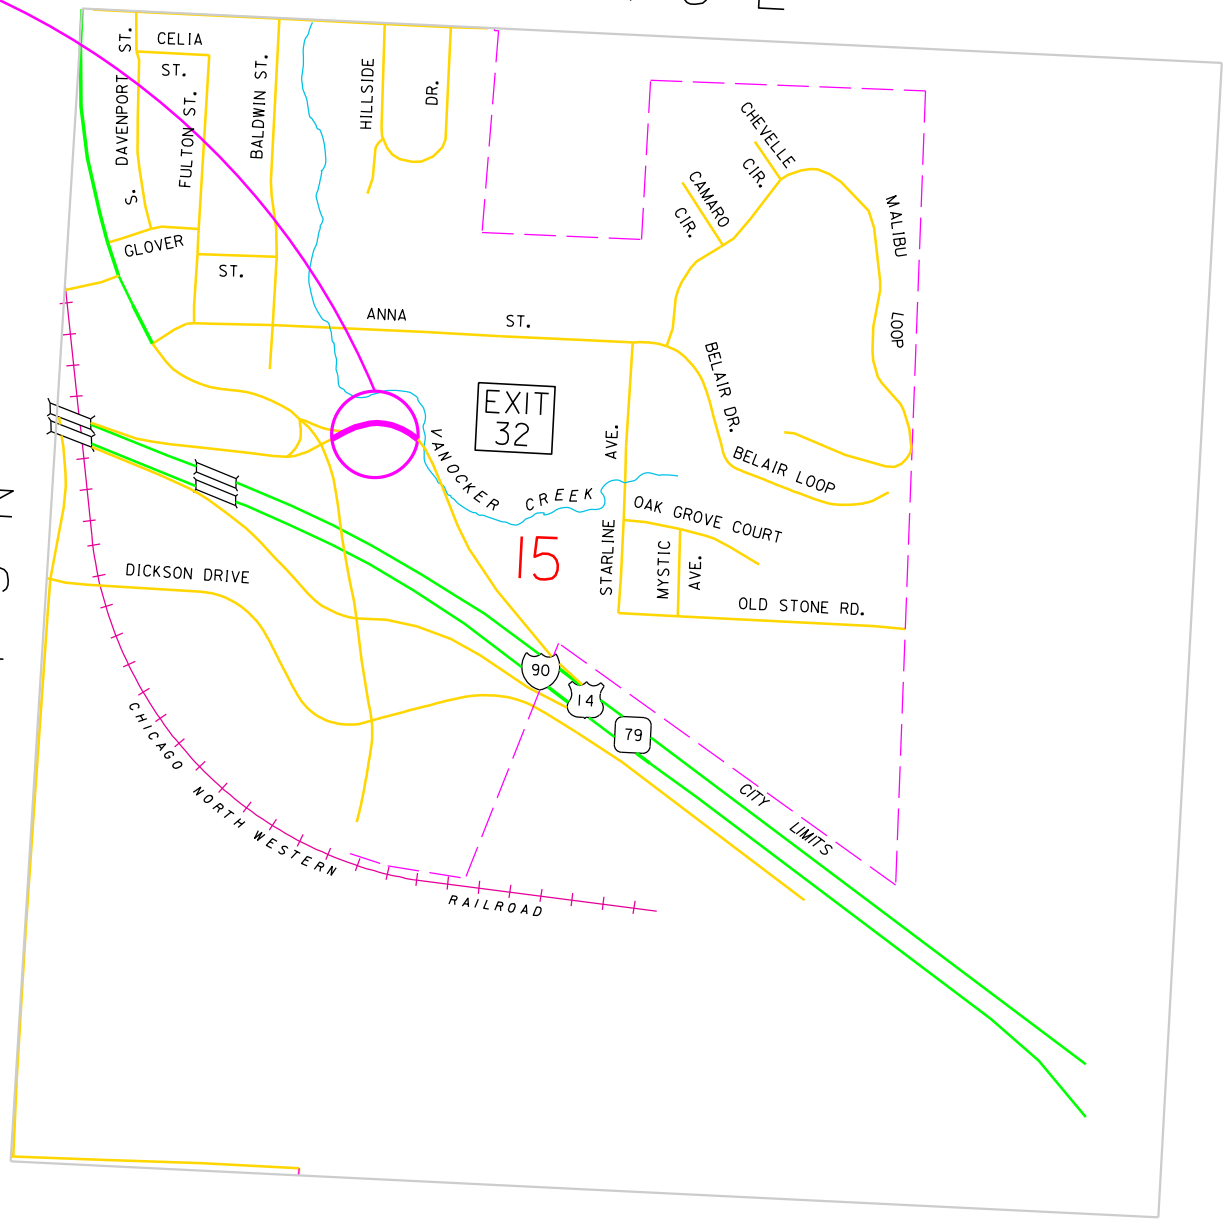

DESIGN DESIGNATION

AADT (2015)	2743
AADT (2035)	3859
DHV	0
D	99%
DHV T%	4.6%
AADT T%	10%
V	30 mph

STORM WATER PERMIT
None Required

STATE OF SOUTH DAKOTA	PROJECT	SHEET	TOTAL SHEETS
	090 W-451	1	11

Plotting Date: 02/08/2023

INDEX OF SHEETS

1	General Layout with Index
2-4	Estimate with General Notes & Tables
5-6	Special Details
7-11	Standard Plates

ESTIMATE OF QUANTITIES

BID ITEM NUMBER	ITEM	QUANTITY	UNIT
009E0010	Mobilization	Lump Sum	LS
120E0010	Unclassified Excavation	4	CuYd
230E0020	Contractor Furnished Topsoil	31	CuYd
260E2010	Gravel Cushion	60.0	Ton
380E1000	6" Miscellaneous PCC Pavement	11.8	SqYd
380E6110	Insert Steel Bar in PCC Pavement	214	Each
634E0110	Traffic Control Signs	87.3	SqFt
634E0120	Traffic Control, Miscellaneous	Lump Sum	LS
650E0090	Type B69 Concrete Curb and Gutter	496	Ft
650E4689	Modified Type P9 Concrete Gutter	34	Ft
650E9000	Repair Concrete Curb and/or Gutter	6	Ft
730E0210	Type F Permanent Seed Mixture	7	Lb
731E0100	Fertilizing	12	Lb
732E0250	Fiber Mulching	270	Lb
900E5147	Articulated Concrete Mattress	97.8	SqYd

SPECIFICATIONS

Standard Specifications for Roads and Bridges, 2015 Edition and Required Provisions, Supplemental Specifications, and Special Provisions as included in the Proposal.

ENVIRONMENTAL COMMITMENTS

The SDDOT is committed to protecting the environment and uses Environmental Commitments as a communication tool for the Engineer and Contractor to ensure that attention is given to avoid, minimize, and/or mitigate an environmental impact. Environmental commitments to various agencies and the public have been made to secure approval of this project. An agency with permitting authority can delay a project if identified environmental impacts have not been adequately addressed. Unless otherwise designated, the Contractor’s primary contact regarding matters associated with these commitments will be the Project Engineer. During construction, the Project Engineer will verify that the Contractor has met Environmental Commitment requirements. These environmental commitments are not subject to change without prior written approval from the SDDOT Environmental Office.

Additional guidance on SDDOT’s Environmental Commitments can be accessed through the Environmental Procedures Manual found at: <<https://dot.sd.gov/media/documents/EnvironmentalProceduresManual.pdf> >

For questions regarding change orders in the field that may have an effect on an Environmental Commitment, the Project Engineer will contact the Environmental Engineer at 605-773-3180 or 605-773-4336 to determine whether an environmental analysis and/or resource agency coordination is necessary.

Once construction is complete, the Project Engineer will review all environmental commitments for the project and document their completion.

COMMITMENT B: FEDERALLY THREATENED, ENDANGERED, AND PROTECTED SPECIES

COMMITMENT B2: WHOOPING CRANE

The Whooping Crane is a spring and fall migratory bird in South Dakota that is about 5 feet tall and typically stops on wetlands, rivers, and agricultural lands along their migration route. An adult Whooping Crane is white with a red crown and a long, dark, pointed bill. Immature Whooping Cranes are cinnamon brown. While in flight, their long necks are kept straight and their long dark legs trail behind. Adult Whooping Cranes' black wing tips are visible during flight.

Action Taken/Required:

Harassment or other measures to cause the Whooping Crane to leave the site is a violation of the Endangered Species Act. If a Whooping Crane is sighted roosting in the vicinity of the project, borrow pits, or staging areas associated with the project, cease construction activities in the affected area until the Whooping Crane departs and immediately contact the Project Engineer. The Project Engineer will contact the Environmental Office so that the sighting can be reported to USFWS.

COMMITMENT C: WATER SOURCE

The Contractor will not withdraw water with equipment previously used outside the State of South Dakota or previously used in aquatic invasive species (AIS) positive waters within South Dakota without prior approval from the SDDOT Environmental Office. To prevent and control the introduction and spread of invasive species into the project vicinity, all equipment will be power washed with hot water (≥140 °F) and completely dried for a minimum of 7 days prior to subsequent use. South Dakota administrative rule 41:10:04:02 forbids the possession and transport of AIS; therefore, all attached dirt, mud, debris and vegetation must be removed and all compartments and tanks capable of holding standing water must be drained. This includes, but is not limited to, all equipment, pumps, lines, hoses and holding tanks.

Action Taken/Required:

The Contractor will obtain the necessary permits from the regulatory agencies such as the South Dakota Department of Agriculture and Natural Resources (DANR) and the United States Army Corps of Engineers (USACE) prior to water extraction activities.

Additional information and mapping of water sources impacted by Aquatic Invasive Species in South Dakota can be accessed at: < <http://sdleastwanted.com/maps/default.aspx> >

< [South Dakota Administrative Rule 41:10:04 Aquatic Invasive Species: https://sdlegislature.gov/rules/DisplayRule.aspx?Rule=41:10:04](https://sdlegislature.gov/rules/DisplayRule.aspx?Rule=41:10:04) >

COMMITMENT E: STORM WATER

Construction activities constitute less than 1 acre of disturbance.

Action Taken/Required:

At a minimum and regardless of project size, appropriate erosion and sediment control measures must be installed to control the discharge of pollutants from the construction site.

COMMITMENT H: WASTE DISPOSAL SITE

The Contractor will furnish a site(s) for the disposal of construction and/or demolition debris generated by this project.

Action Taken/Required:

Construction and/or demolition debris may not be disposed of within the Public ROW.

The waste disposal site(s) will be managed and reclaimed in accordance with the following from the General Permit for Construction/Demolition Debris Disposal Under the South Dakota Waste Management Program issued by the Department of Agriculture and Natural Resources.

The waste disposal site(s) will not be located in a wetland, within 200 feet of surface water, or in an area that adversely affects wildlife, recreation, aesthetic value of an area, or any threatened or endangered species, as approved by the Environmental Office and the Project Engineer.

If the waste disposal site(s) is located such that it is within view of any ROW, the following additional requirements will apply:

1. Construction and/or demolition debris consisting of concrete, asphalt concrete, or other similar materials will be buried in a trench separate from wood debris. The final cover over the construction and/or demolition debris will consist of a minimum of 1 foot of soil capable of supporting vegetation. Waste disposal sites provided outside of the Public ROW will be seeded in accordance with Natural Resources Conservation Service recommendations. The seeding recommendations may be obtained through the appropriate County NRCS Office. The Contractor will control the access to waste disposal sites not within the Public ROW with fences, gates, and placement of a sign or signs at the entrance to the site stating, “No Dumping Allowed”.

2. Concrete and asphalt concrete debris may be stockpiled within view of the ROW for a period not to exceed the duration of the project. Prior to project completion, the waste will be removed from view of the ROW or buried, and the waste disposal site reclaimed as noted above.

The above requirements will not apply to waste disposal sites that are covered by an individual solid waste permit as specified in SDCL 34A-6-58, SDCL 34A-6-1.13, and ARSD 74:27:10:06. Failure to comply with the requirements stated above may result in civil penalties in accordance with South Dakota Solid Waste Law, SDCL 34A-6-1.31.

All costs associated with furnishing waste disposal site(s), disposing of waste, maintaining control of access (fence, gates, and signs), and reclamation of the waste disposal site(s) will be incidental to the various contract items.

STATE OF SOUTH DAKOTA	PROJECT	SHEET	TOTAL SHEETS
	090 W-451	3	11

COMMITMENT I: HISTORICAL PRESERVATION OFFICE CLEARANCES

State Historic Preservation Office (SHPO or THPO) concurrence has not been obtained for this project.

Action Taken/Required:

All earth disturbing activities not designated within the plans require a cultural resource review prior to scheduling the pre-construction meeting. This work includes but is not limited to: Contractor furnished material sources, material processing sites, stockpile sites, storage areas, plant sites, and waste areas.

The Contractor will arrange and pay for a record search and when necessary, a cultural resource survey. The Contractor has the option to contact the state Archaeological Research Center (ARC) at 605-394-1936 or another qualified archaeologist, to obtain either a records search or a cultural resources survey. A record search might be sufficient for review if the site was previously surveyed; however, a cultural resources survey may need to be conducted by a qualified archaeologist.

The Contractor will provide ARC with the following: a topographical map or aerial view in which the site is clearly outlined, site dimensions, project number, and PCN. If applicable, provide evidence that the site has been previously disturbed by farming, mining, or construction activities with a landowner statement that artifacts have not been found on the site.

The Contractor will submit the cultural resources survey report to SDDOT Environmental Office, 700 East Broadway Avenue, Pierre, SD 57501-2586. SDDOT will submit the information to the appropriate SHPO/THPO. Allow **30 Days** from the date this information is submitted to the Environmental Engineer for SHPO/THPO review.

In the event of an inadvertent discovery of human remains, funerary objects, or if evidence of cultural resources is identified during project construction activities, then such activities within 100 feet of the inadvertent discovery will immediately cease and the Project Engineer will be immediately notified. The Project Engineer will contact the SDDOT Environmental Office, who will contact the appropriate SHPO/THPO within 48 hours of the discovery to determine an appropriate course of action.

SHPO/THPO review does not relieve the Contractor of the responsibility/[The Contractor is responsible](#) for obtaining any additional permits and clearances for Contractor furnished material sources, material processing sites, stockpile sites, storage areas, plant sites, and waste areas that affect wetlands, threatened and endangered species, or waterways. The Contractor will not utilize a site known or suspected of having contaminated soil or water. The Contractor will provide the required permits and clearances to the Project Engineer at the preconstruction meeting.

UTILITIES

The Contractor will contact the involved utility companies through South Dakota One Call (1-800-781-7474) prior to starting work. It will be the responsibility of the Contractor to coordinate work with the utility owners to avoid damage to existing facilities.

If utilities are identified near the improvement area through the SD One Call Process as required by South Dakota Codified Law 49-7A and Administrative Rule Article 20:25, the Contractor will contact the Project Engineer to determine modifications that will be necessary to avoid utility impacts.

REPAIR CONCRETE CURB AND/OR GUTTER

The existing curb taper will need to be modified as needed to match the new curb and gutter. All costs associated with this curb modification will be incidental to the contract unit price per foot for Repair Concrete Curb and/or Gutter.

Refer to the plan sheet for locations of removal and replacement. The limits at this location will be designated by the Engineer on construction.

The existing concrete curb and gutter is Type **B69**. New curb **and/or** gutter will match in place.

If the end of any section to be removed does not fall on an existing joint, a sawed joint (**3" to 4" deep**) must be made to provide a vertical face for the new joint.

Existing foundation material will be shaped and compacted to a firm, uniform bearing surface, conforming to the existing section or established grades as set by the Engineer. Unsuitable foundation material will be removed and replaced as directed.

Cost for labor, equipment, material and incidentals required for excavation and providing cushion material will be incidental to the contract unit prices for the various items.

Curb **and/or** Gutter will be tied to existing PCC pavement with drilled in No. **5 x 30"** epoxy coated deformed tie bars spaced 30" center to center or by salvaged in place tie bars. Also, two No. 5 x 30" epoxy coated deformed tie bar will be drilled into the existing curb **and/or** gutter at each end of the replacement area. Refer to the notes for Steel Bar Insertion.

Cost for this work will be included in the contract unit price per each for Insert Steel Bar in PCC Pavement.

The Contractor will satisfactorily restore disturbed areas adjacent to the new concrete placement to the satisfaction of the Engineer. Cost for this restoration work will be incidental to the contract unit prices for the various items.

Standard specifications for sawing, removing and replacing concrete curb and/or gutter, and material composition will apply except that the cost for such will be included in the contract unit price per foot for Repair Concrete Curb and/or Gutter.

UNCLASSIFIED EXCAVATION

Unclassified excavation is provided for removal of material and site preparation prior to placement of 6" Miscellaneous PCC Pavement and for reshaping of erosional areas. Excavated waste material may be used to shape behind the new PCC Pavement. Any excess excavated material not used for the project will be treated as waste material.

GRAVEL CUSHION

Gravel Cushion will be placed to a depth of 5" and compacted to the satisfaction of the Engineer prior to placement of the 6" Miscellaneous PCC Pavement.

Gravel Cushion will also be used for Curb and Gutter installation.

Water for compaction will be to the satisfaction of the Engineer.

All cost for water for compaction will be incidental to the unit price per ton for Gravel Cushion.

STEEL BAR INSERTION

Steel bars will be used to tie new pavement and curb and gutter to the existing pavement.

The Contractor will insert the Steel Bars (No.5 x 30 inch epoxy coated deformed tie bars) into drilled holes in the existing concrete pavement. An epoxy resin adhesive must be used to anchor the steel bar in the drilled hole.

The steel bars will be cut to the specified length by sawing or shearing and will be free from burring or other deformations.

Epoxy coated deformed steel bars will be inserted on 30-inch centers in the longitudinal joint and will be placed a minimum of 15 inches from the existing transverse contraction joint.

SEQUENCE OF OPERATIONS

The Contractor will submit a sequence of operations for approval two weeks prior to the preconstruction meeting. If changes to the sequence of operations are proposed during the project, these must be submitted for review a minimum of one week prior to potential implementation. Approval for changes to the sequence of operations will only be allowed when the proposed changes meet with the Department's intent for traffic control and sequencing of the work.

GENERAL TRAFFIC CONTROL

Existing guide, route, informational logo, regulatory, and warning signs will be temporarily reset and maintained during construction. Removing, relocating, covering, salvaging, and resetting of existing traffic control devices, including delineation, will be the responsibility of the Contractor. Cost for this work will be incidental to the contract unit prices for the various items unless otherwise specified in the plans. Any delineators and signs damaged or lost will be replaced by the Contractor at no cost to the State.

All temporary traffic control sign locations will be set in the field by the Contractor and verified by the Engineer prior to installation.

All construction operations will be conducted in the general direction of traffic movement.

If there is a discrepancy between the traffic control plans, standard plates, and the MUTCD, whichever is more stringent will be used, as determined by the Engineer.

Unless otherwise stated in these plans, work will not be allowed during hours of darkness.

Fixed location signing placed more than 4 calendar days prior to the start of construction will be covered or laid down until the time of construction. The covers must be approved by the Engineer prior to installation. The cost of materials, labor, and equipment necessary to complete this work will be incidental to other contract items. No separate payment will be made.

All fixed location signs, sign posts, and breakaway bases will be removed within 7 calendar days following pavement marking.

At no time will a vertical drop-off of greater than 3 inches be left overnight adjacent to the traveled way. The Contractor will utilize embankment material to ensure a 3-inch vertical drop-off is not exceeded. The slope of the embankment material will not be steeper than a 4:1 within 30 feet of the traveled way

INVENTORY OF TRAFFIC CONTROL DEVICES

		EXPRESSWAY / INTERSTATE			
SIGN CODE	SIGN DESCRIPTION	NUMBER	SIGN SIZE	SQFT PER SIGN	SQFT
W5-4	RAMP NARROWS	1	48" x 48"	16.0	16.0
W13-1P	ADVISORY SPEED (plaque)	1	30" x 30"	6.3	6.3
W13-4P	ON RAMP (plaque)	1	36" x 36"	9.0	9.0
W20-1	ROAD WORK AHEAD	2	48" x 48"	16.0	32.0
W21-5	SHOULDER WORK	1	48" x 48"	16.0	16.0
G20-2	END ROAD WORK	1	48" x 24"	8.0	8.0
		EXPRESSWAY / INTERSTATE TRAFFIC CONTROL SIGNS SQFT			
		87.3			

CONTRACTOR FURNISHED TOPSOIL

The Contactor will be required to furnish and place 4 inches of topsoil on areas as determined by the Engineer during construction.

Contractor furnished topsoil will be free from stones, coarse gravel, or similar objects larger than 3/4 inch in diameter. Brush, stumps, roots, wood, objectionable weeds, liter, or any other material which may be harmful to plant growth will not be allowed. Organic material will be decomposed.

All costs to furnish and place the Contractor furnished topsoil will be incidental to the contract unit price per cubic yard for Contractor Furnished Topsoil.

FERTILIZING

A commercial fertilizer with a minimum guaranteed analysis of 13-13-13, 18-46-0, 11-52-0, or an approved alternate fertilizer sold for use as a lawn starter fertilizer will be applied to all areas designated for permanent seeding. The application rate of fertilizer will be 3 pounds per 1,000 square feet.

PERMANENT SEEDING

The areas to be seeded consist of all newly graded areas within the project limits except for the top of roadways and temporary easements under cultivation.

Type F Permanent Seed Mixture will consist of the following:

Grass Species	Variety	Pure Live Seed (PLS) (Pounds/Acre)
Western Wheatgrass	Arriba, Flintlock, Rodan, Rosana, Walsh	21
Green Needlegrass	Lodorm, AC Mallard Ecovar	12
Sideoats Grama	Butte, Pierre	9
Blue Grama	Bad River	6
Oats or Spring Wheat: April through May; Winter Wheat: August through November		30
Total:		78

FIBER MULCHING

Fiber mulch will be applied in a separate operation following permanent seeding.

An additional 2% by weight of tackifier will be added to the fiber mulch product selected from the approved product list. If the product selected has guar gum tackifier included, then the additional 2% of tackifier will be guar gum. If the product selected has synthetic tackifier included, then the additional 2% of tackifier will be synthetic.

Fiber mulch will be applied at the rate of 3,000 pounds per acre.

The Contractor will allow the fiber mulch to cure a minimum of 18 hours prior to watering or any storm event to ensure proper cohesion between the soil and fiber particles.

All costs for the additional tackifier added to the fiber mulch including labor, equipment, and materials will be incidental to the contract unit price per pound for "iber Mulching.

The fiber mulch provided will be from the approved product list. The approved product list for fiber mulch may be viewed at the following internet site:

<http://apps.sd.gov/HC60ApprovedProducts/main.aspx>

ARTICULATED CONCRETE MATTRESS

Articulated concrete mattress will be installed at locations noted in the table and at locations determined by the Engineer during construction.

Installation of the articulated concrete mattress will be in accordance with the manufacturer's installation instructions.

All costs for furnishing and installing the articulated concrete mattress including hauling, materials, equipment, labor, and incidentals necessary will be paid for at the contract unit price per square yard for Articulated Concrete Mattress.

The articulated concrete mattress will be as shown below or an approved equal:

Product

Standard Flexamat

Manufacturer

Flexamat Permanent Site Solutions
Cincinnati, Ohio
Phone: (513) 772-6690
www.flexamat.com

Product


ShoreFlex

Manufacturer

ShoreFlex
Denham Springs, Louisiana
Phone: (800) 575-7293
www.shoreflex.com

Diagram illustrating the cross-section of a proposed concrete curb and gutter. The structure includes a 6:1 slope on the left, a 5' wide area of Contractor Furnished Topsoil, a 3.67' wide Type B69 C&G curb, a 4' wide area, a 21' wide area with a 0.02'/ft slope, and a 7' wide area. The curb is 5' high. The base consists of a 5' Gravel Cushion and a 9' Nonreinforced PCC Pavement In-Place. A centerline (CL) is marked.

- 1 Remove Existing Concrete Curb Taper.
Removal will be performed in accordance with Section 110 of the Specifications.
(Repair Concrete Curb and/or Gutter)
Modify Curb as needed to match New Curb,
Construct in accordance with Section 650 of the Specifications.
(Repair Concrete Curb and/or Gutter)
Begin straight C&G
- 2 End Straight C&G
Begin 267" Radius C&G
- 3 End 267" Radius C&G
Begin Special Curb Opening
- 4 End Special Curb Opening
Begin 267" Radius C&G
- 5 End 267" Radius C&G
Begin Special Outlet
- 6 End Special Curb Opening
Begin C&G Tapered End
- 7 End Special Curb Opening
Begin C&G Tapered End

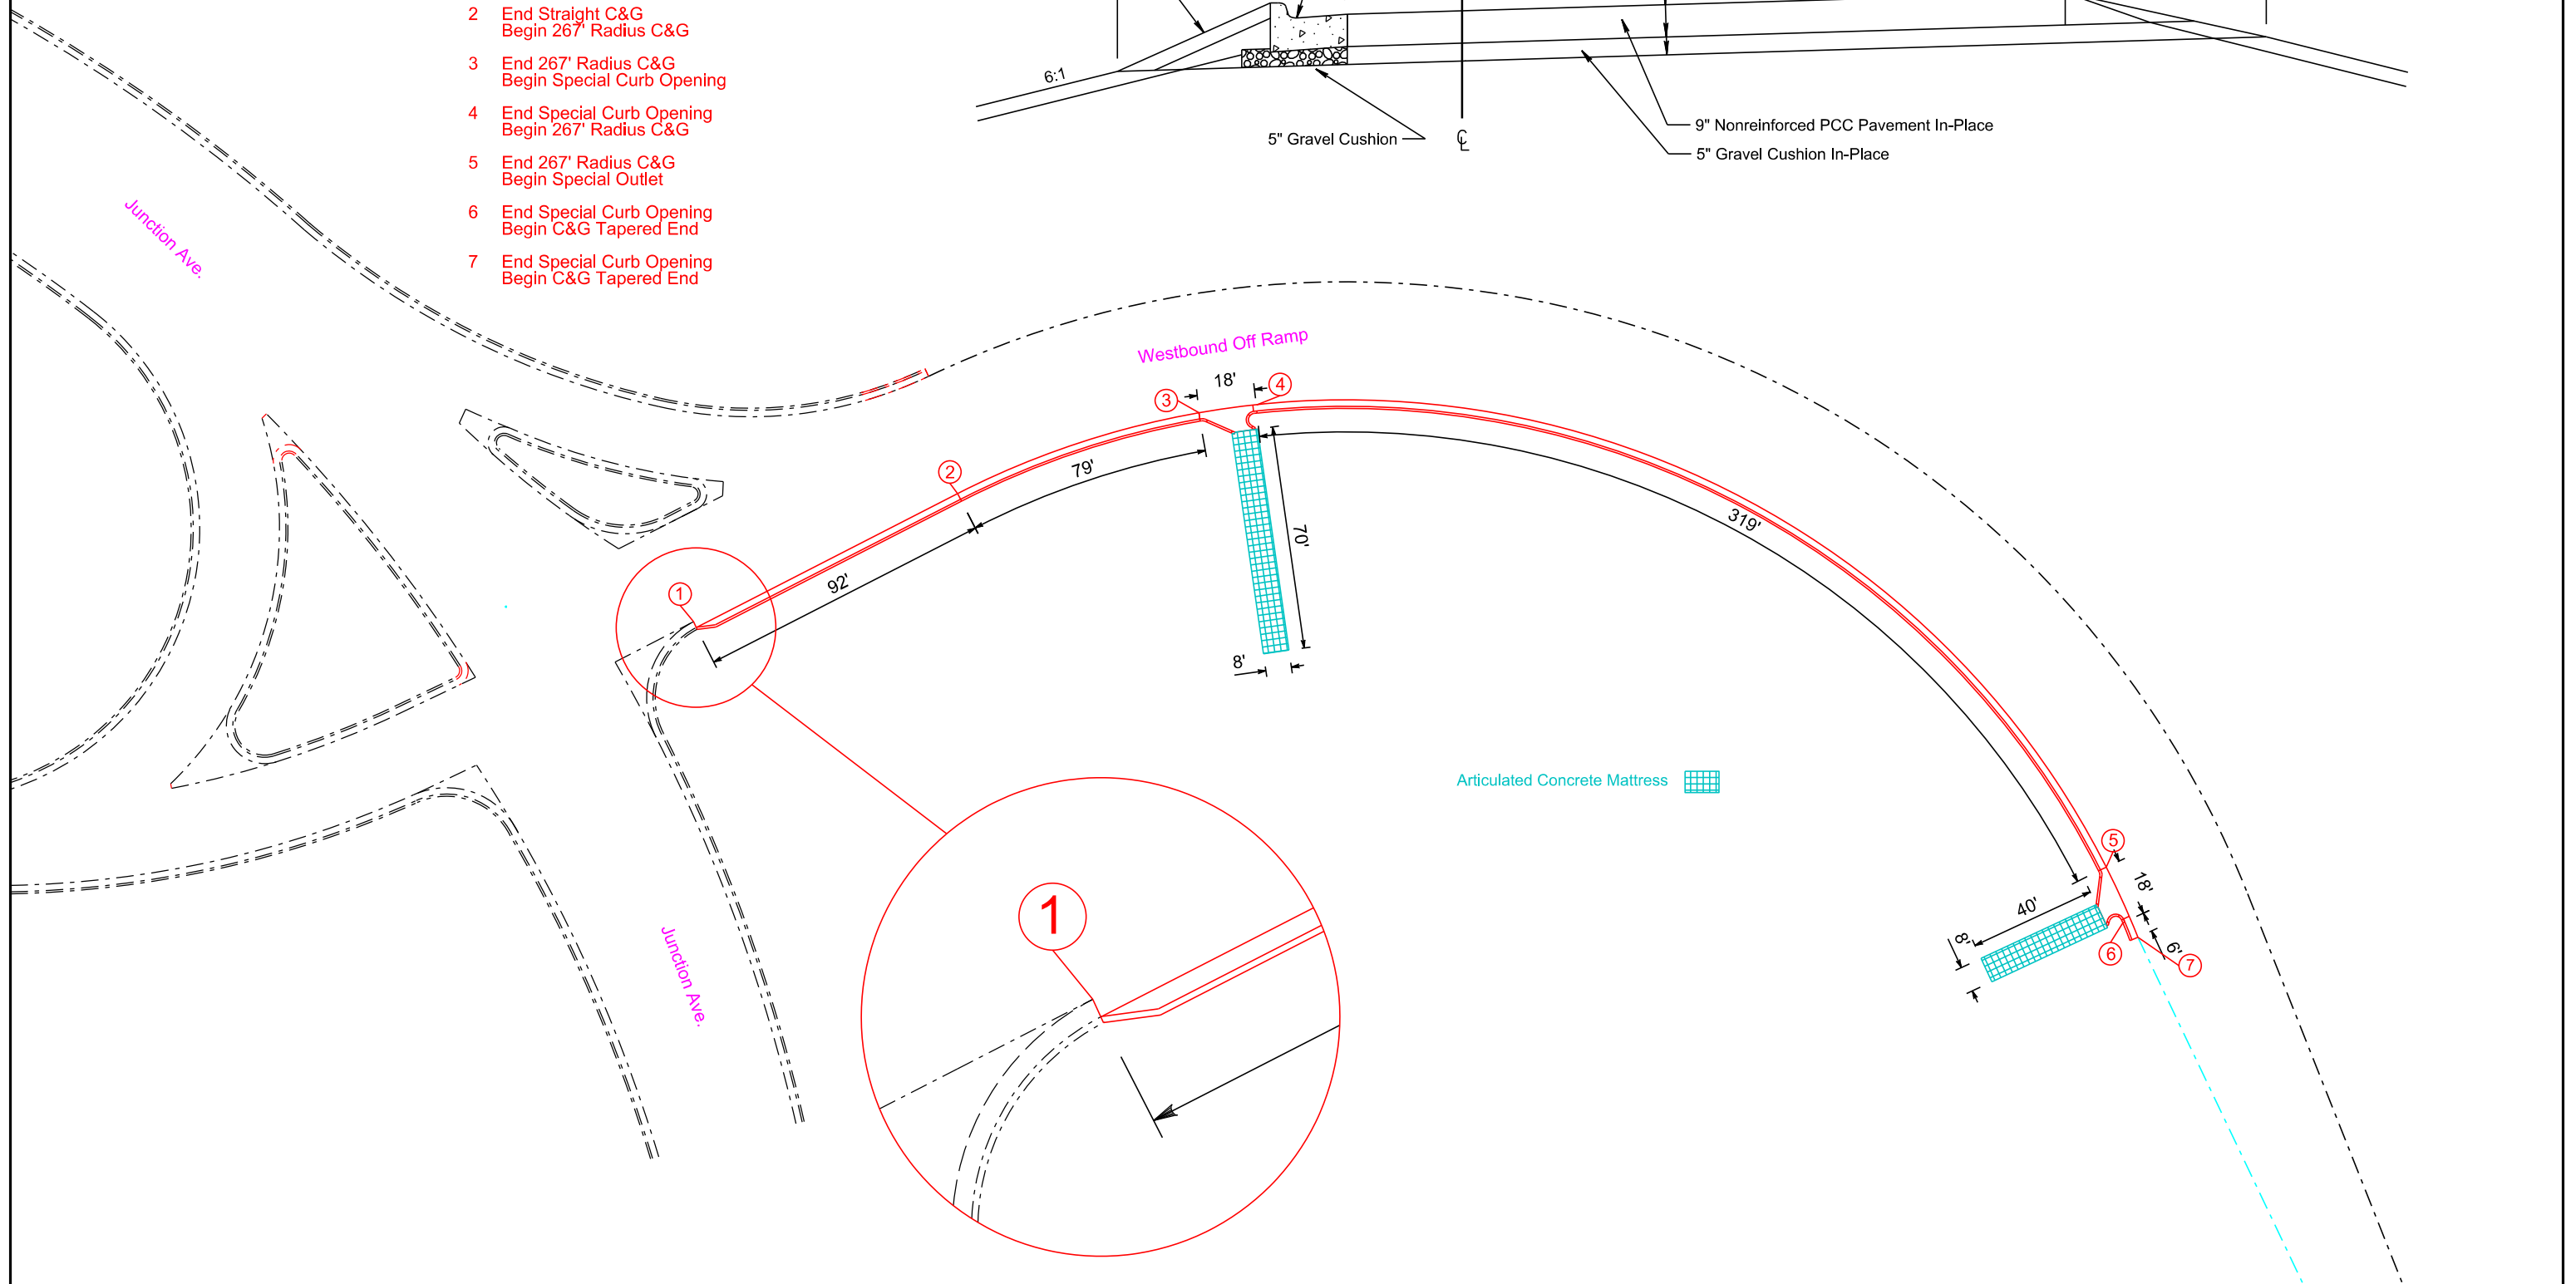

PLOT SCALE - 1:3.54153


PLOTTED FROM - TRRC12608

CURB OPENING DETAILS

STATE OF SOUTH DAKOTA	PROJECT	SHEET	TOTAL SHEETS
	090 W-451	6	11

Plotting Date: 02/08/2023

MODIFIED TYPE P9 CONCRETE GUTTER

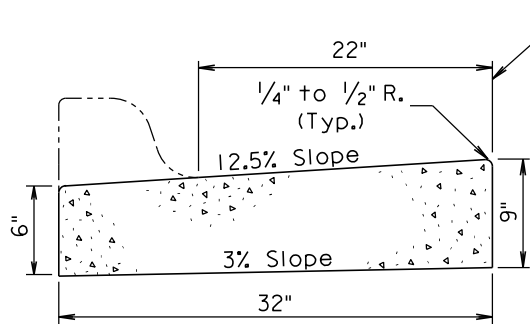

Cu. Yd. Per Lin. Ft.	Lin. Ft. Per Cu. Yd.
0.062	16.1

TRANSVERSE SECTION

GENERAL NOTES:

The concrete for the Modified Type P9 Concrete Gutter will comply with the requirements of the Standard Specifications for Class M6 Concrete.

When concrete gutter longitudinally adjoins new concrete pavement, the method of attachment will be by one of the methods shown on Standard Plate 380.11.



Transverse contraction joints will be constructed at 10' intervals in the concrete gutter except when concrete gutter is constructed adjacent to mainline PCC pavement. When concrete gutter is constructed adjacent to mainline PCC pavement, a transverse contraction joint will be constructed in the concrete gutter at each mainline PCC pavement transverse contraction joint location.

When concrete gutter is placed monolithically with mainline PCC pavement, the transverse contraction joints in the concrete gutter will be sawed and sealed the same as the transverse contraction joints in the mainline PCC pavement.


When concrete gutter is not placed monolithically with the mainline PCC pavement and when the adjacent mainline surfacing is not PCC concrete, the transverse contraction joints in the concrete gutter will be 1 1/2 inches deep if formed in the fresh concrete using a suitable grooving tool. If a saw is used to cut the contraction joints, then the depth of the joint will be at least 1/4 the thickness of the concrete.

Curb along 6" Miscellaneous PCC Pavement will be poured monolithically and will be measured and paid as 6" Miscellaneous PCC Pavement.

Flexamat Typical Section

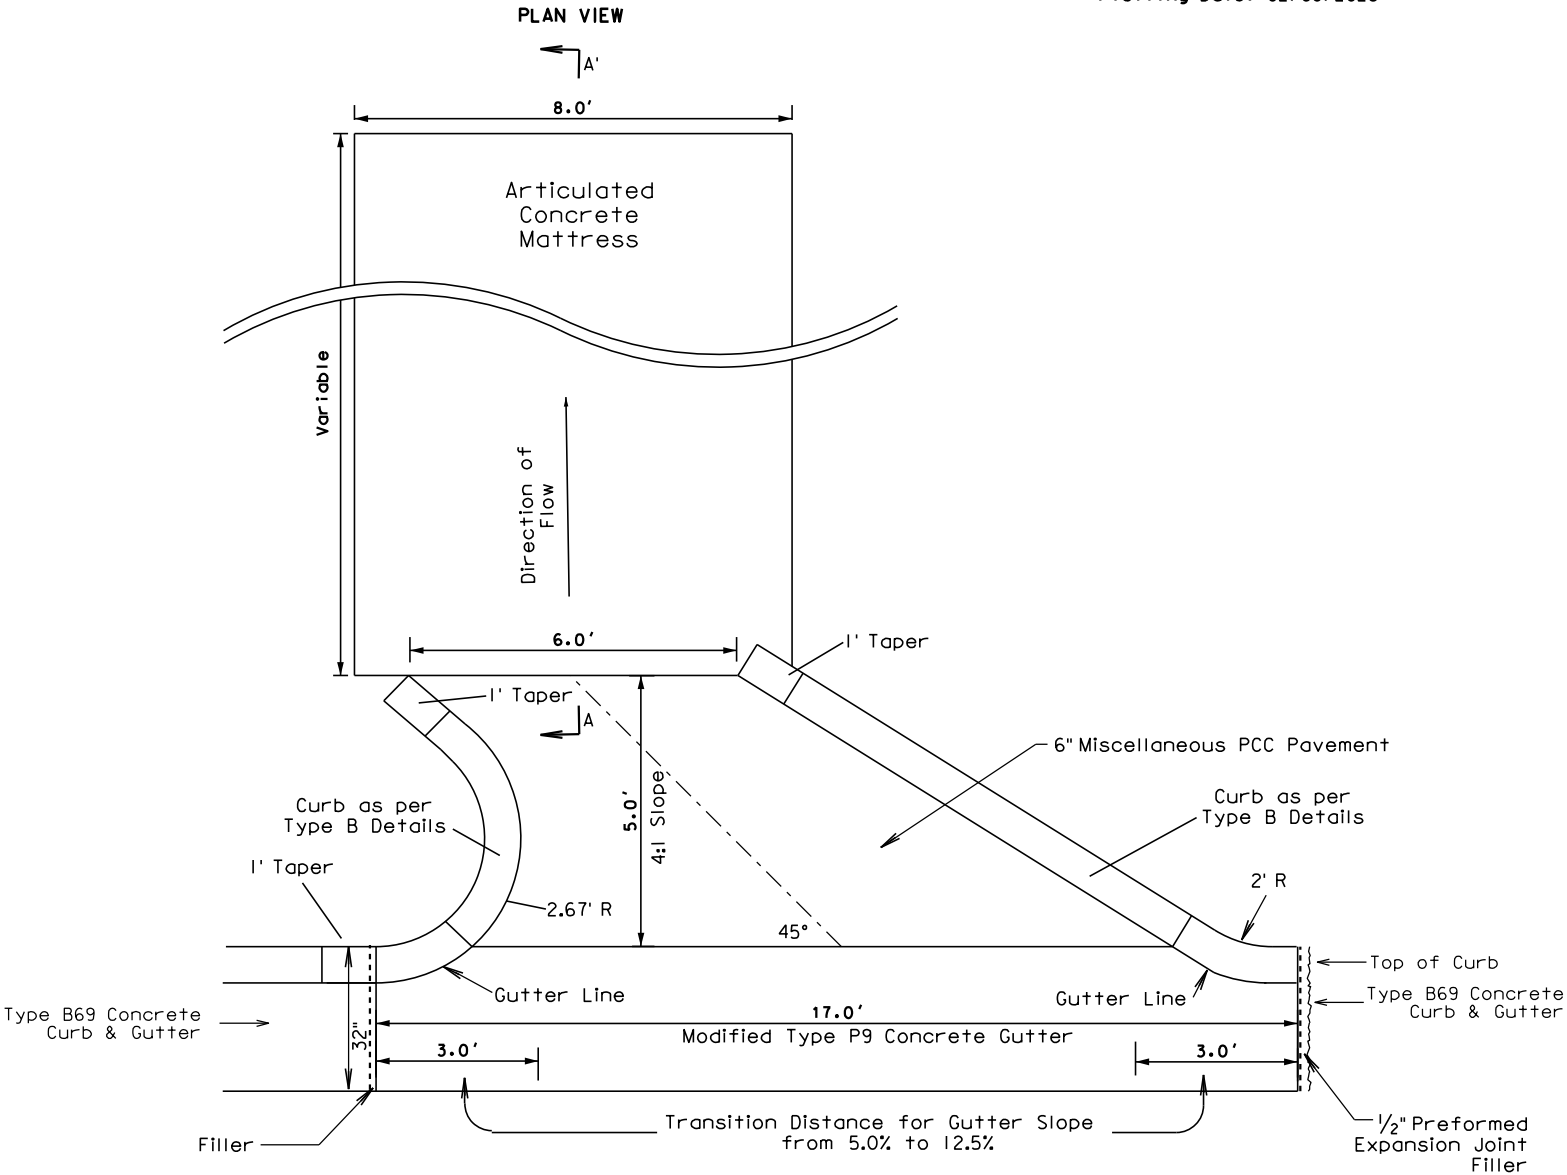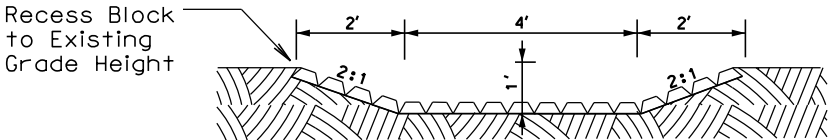

SECTION A-A'

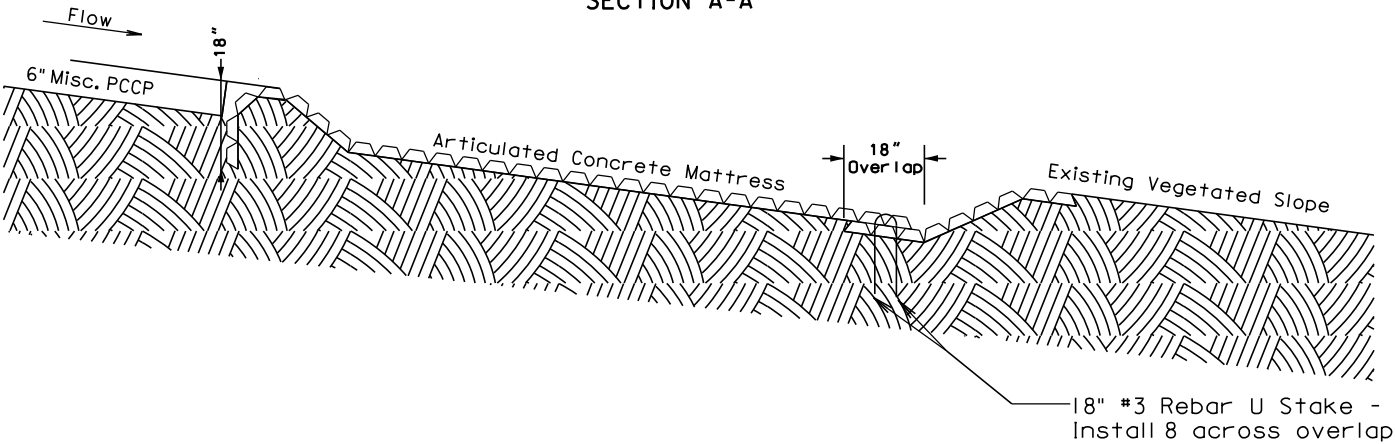

FILE - ... \CURB OPENING DETAIL REFERENCED.DGN PLOT NAME - 3


The signs illustrated are not required if the work space is behind a barrier, more than 2 feet behind the curb, or 15 feet or more from the edge of any roadway.

The signs illustrated will be used where there are distracting situations; such as: vehicles parked on shoulder, vehicles accessing the work site via the highway, and equipment traveling on or crossing the roadway to perform work operations.


The ROAD WORK AHEAD sign may be replaced with other appropriate signs, such as the SHOULDER WORK sign. The SHOULDER WORK sign may be used for work adjacent to the shoulder.

* If the work space is on a divided highway, an advance warning sign should also be placed on the left side of the directional roadway.

For short term, short duration, or mobile operations, all signs and channelizing devices may be eliminated if a vehicle with an activated flashing or revolving yellow light is used.

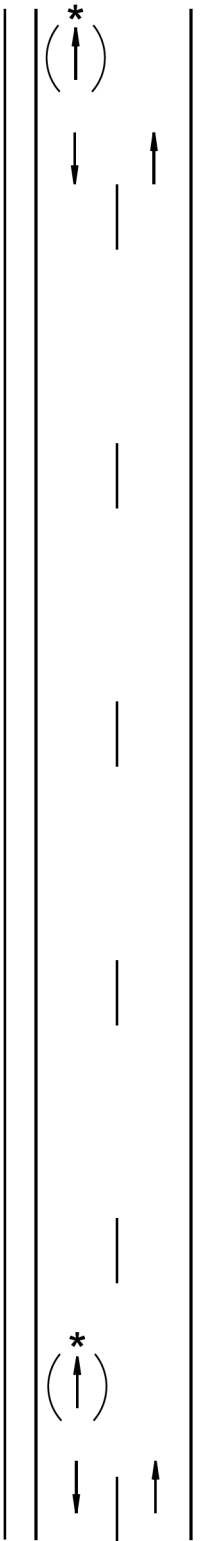


Posted Speed Prior to Work (M.P.H.)	Spacing of Advance Warning Signs (Feet) (A)
0 - 30	200
35 - 40	350
45 - 50	500
55	750
60 - 80	1000

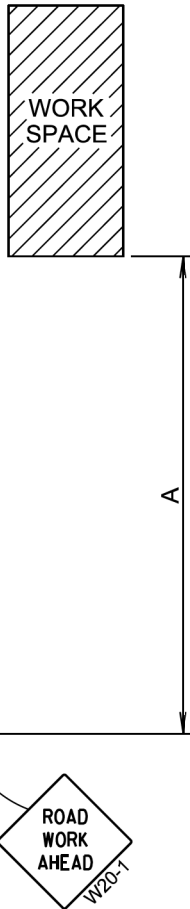


January 22, 2021

Published Date: 1st Qtr. 2023	S D D O T	WORK BEYOND THE SHOULDER	PLATE NUMBER 634.01
			Sheet 1 of 1

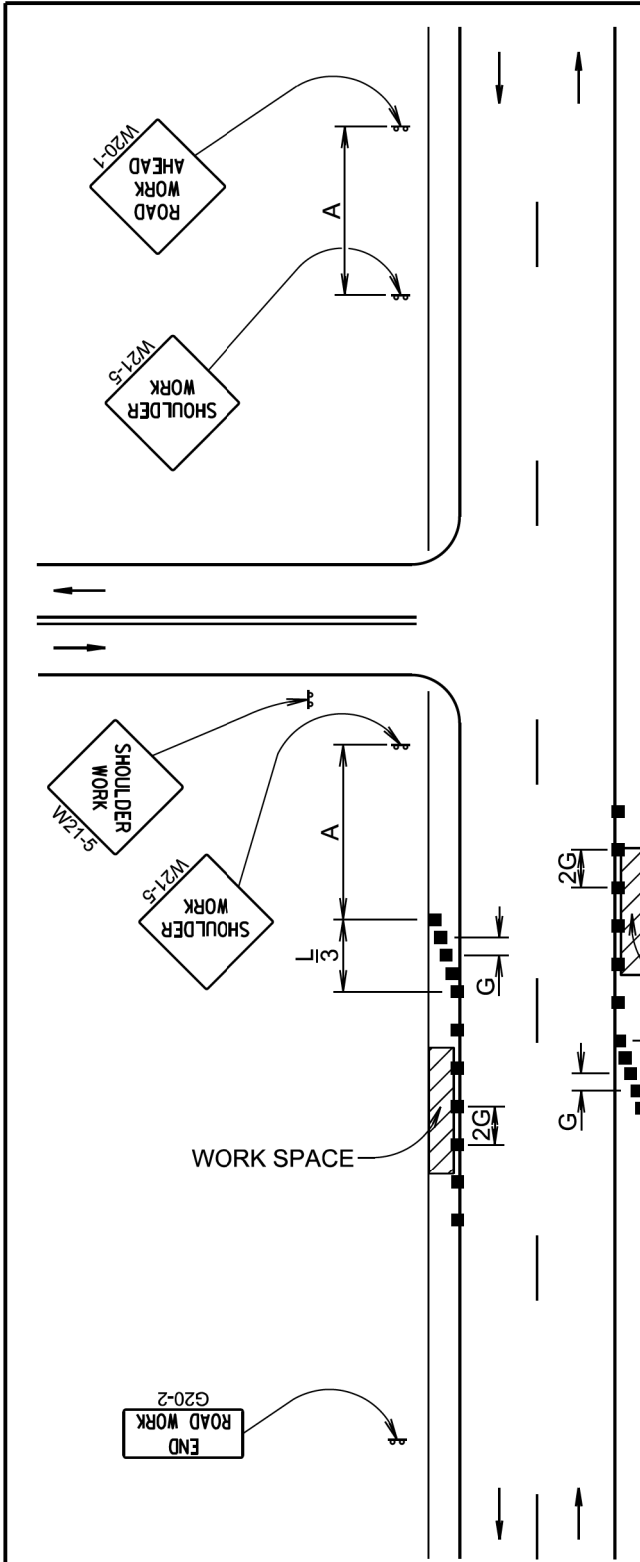

Posted Speed Prior to Work (M.P.H.)	Spacing of Advance Warning Signs (Feet) (A)	Taper Length (Feet) (L)	Spacing of Channelizing Devices (Feet) (G)
0 - 30	200	180	25
35 - 40	350	320	25
45	500	600	25
50	500	600	50
55	750	660	50
60 - 65	1000	780	50

Channelizing Device



The channelizing devices will be drums or 42" cones if traffic control must remain overnight.


For short duration operations (1 hour or less) all channelizing devices may be eliminated if a vehicle with an activated flashing or revolving yellow light is used.

Worker signs (W21-1 or W21-1a) may be used instead of SHOULDER WORK signs.

A SHOULDER WORK sign should be placed on the left side of a divided or one-way roadway only if the left shoulder is affected.

The SHOULDER WORK sign on an intersecting roadway is not required if drivers emerging from that roadway will encounter another advance warning sign before they reach a work activity area.

WORK SPACE

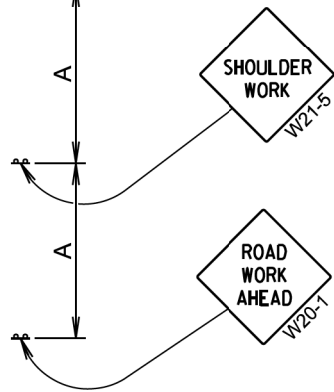

January 22, 2021

Published Date: 1st Qtr. 2023	S D D O T	WORK ON SHOULDERS	PLATE NUMBER 634.03
			Sheet 1 of 1

Posted Speed Prior to Work (M.P.H.)	Spacing of Advance Warning Signs (Feet) (A) (B)		Taper Length (Feet) (L)
45 - 50	500		600
55	750		660
60 - 65	1000		780
	(A)	(B)	
70 - 80	1000	1500	1125

Posted Speed Prior to Work (M.P.H.)	Spacing of Channelizing Devices (Feet) (G)
0 - 30	25
35 - 45	25
50	50 *
55	50 *
60 - 80	50 *

* Spacing is 40' for 42" cones.

■ Channelizing Device


④ W 4" White Temporary Pavement Marking

** Need and safe speed to be determined by the Engineer.

Temporary pavement markings will be used if traffic control must remain overnight.

The channelizing devices will be drums or 42" cones if traffic control must remain overnight.

Truck off-tracking should be considered when determining whether the 10-foot minimum lane width is adequate.

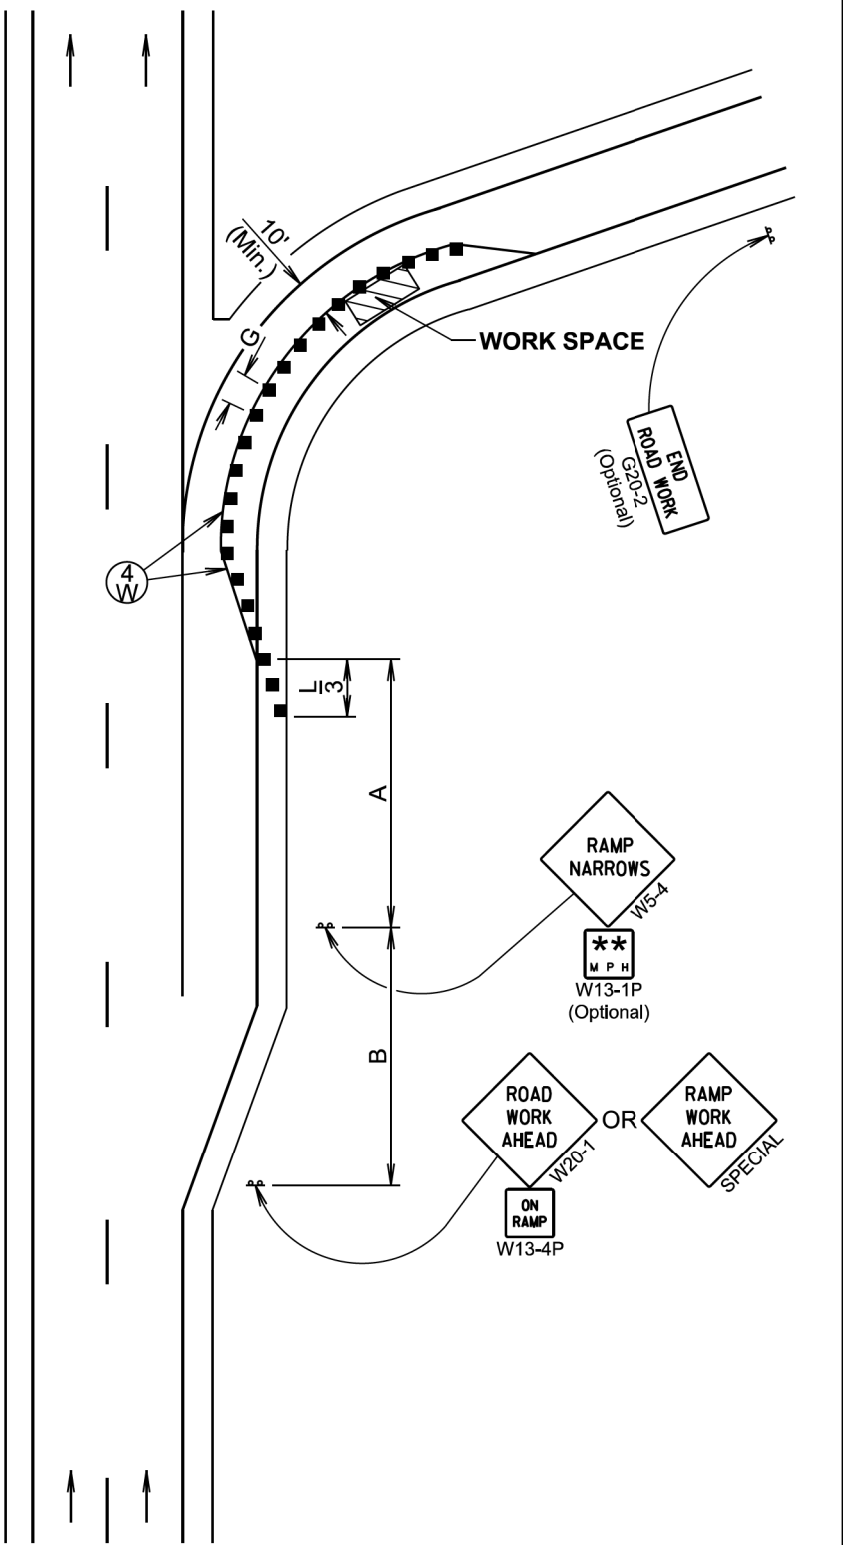

January 22, 2021


S
D
D
O
T

PARTIAL EXIT RAMP CLOSURE


PLATE NUMBER
634.69

Sheet 1 of 1


Published Date: 1st Qtr. 2023

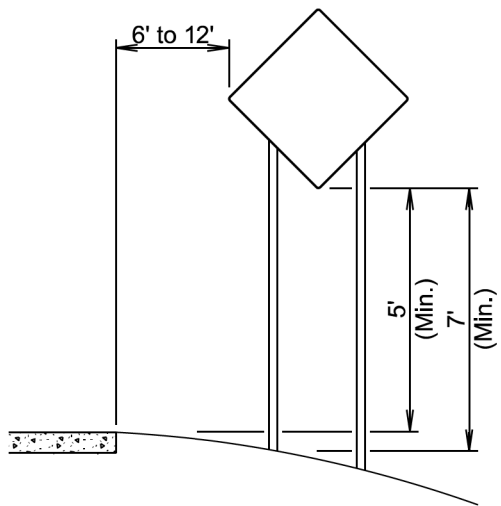


RURAL DISTRICT

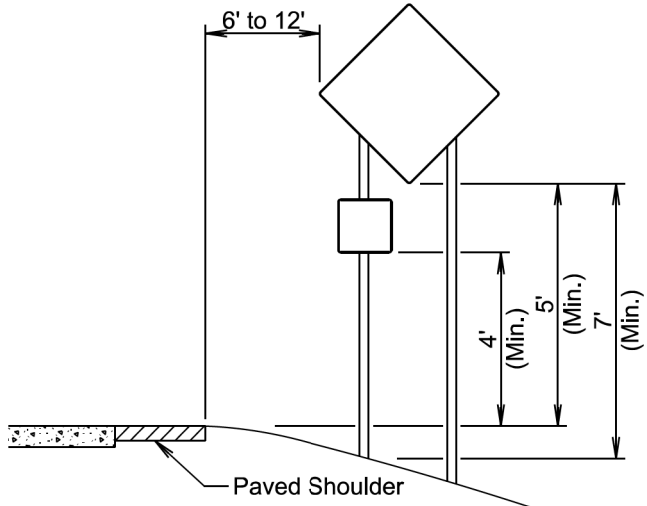

RURAL DISTRICT WITH
SUPPLEMENTAL PLATE

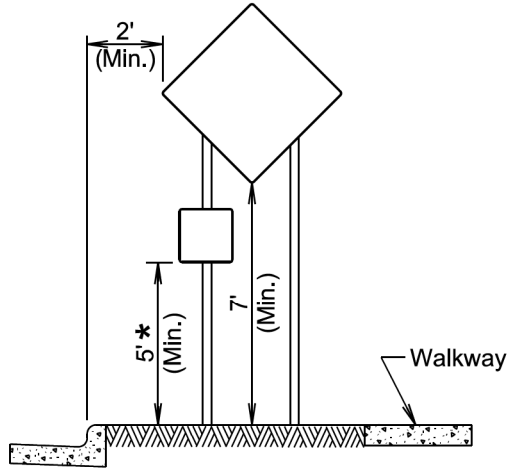

URBAN DISTRICT

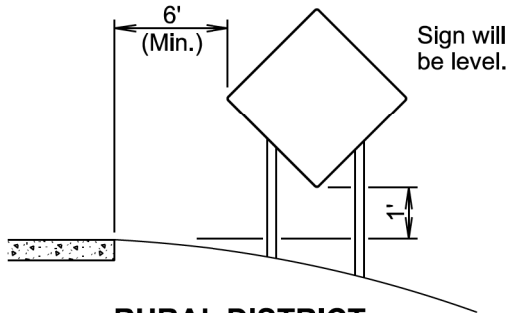

RURAL DISTRICT
3 DAY MAXIMUM

(Not applicable to regulatory signs)

* If the bottom of supplemental plate is mounted lower than 7 feet above a pedestrian walkway, the supplemental plate should not project more than 4" into the pedestrian facility.

January 22, 2021

S
D
D
O
T

CRASHWORTHY SIGN SUPPORTS
(Typical Construction Signing)


PLATE NUMBER
634.85


Sheet 1 of 1

Published Date: 1st Qtr. 2023

STATE OF SOUTH DAKOTA	PROJECT	SHEET	TOTAL SHEETS
	090 W-451	9	11

Plotting Date: 02/08/2023

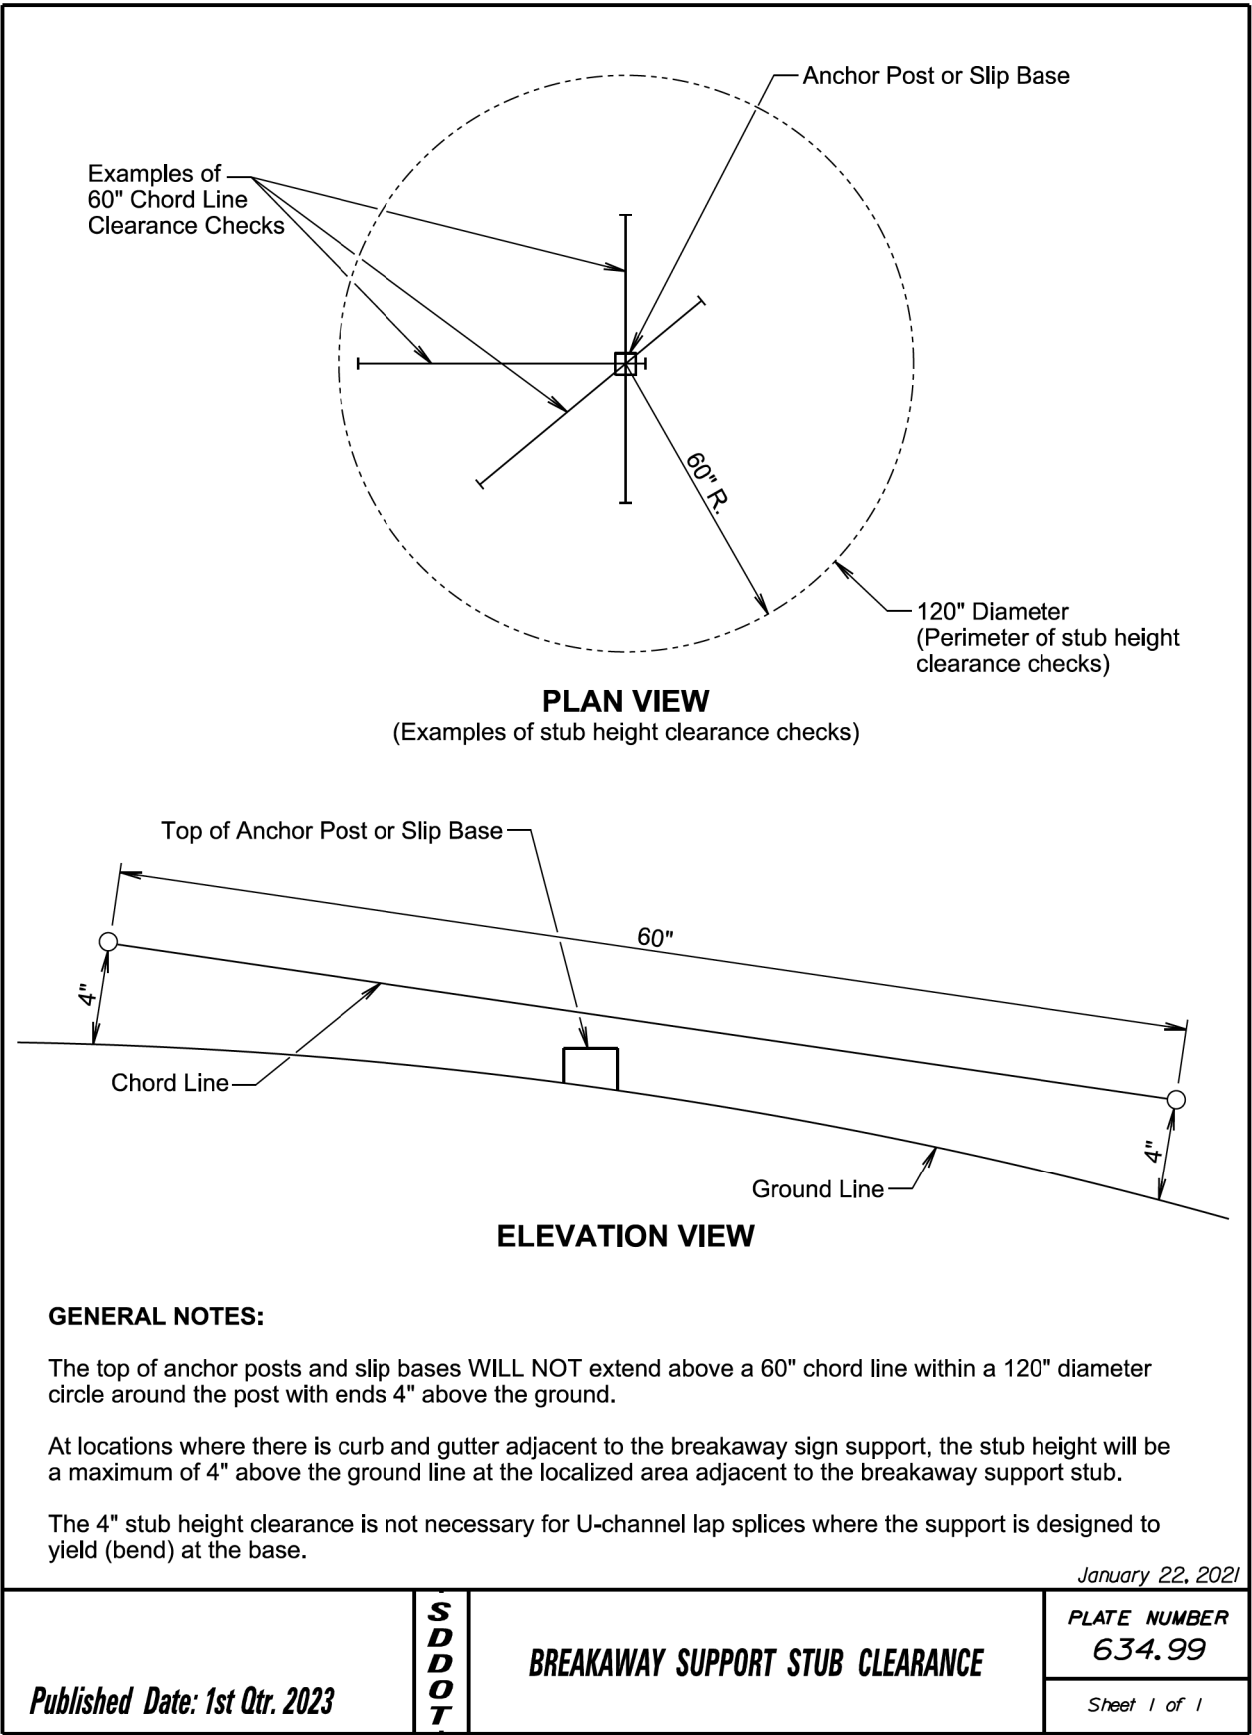

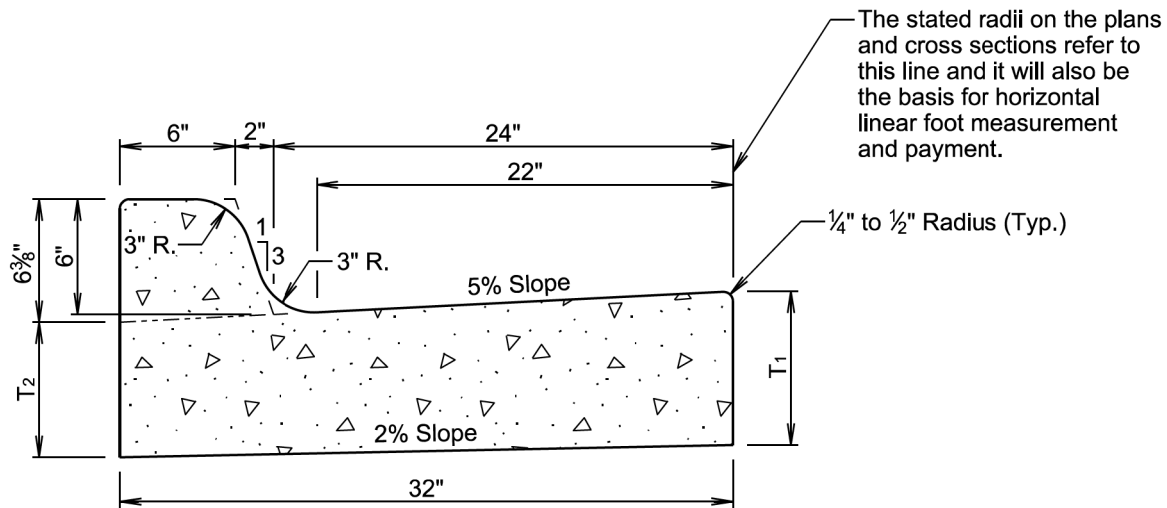

TYPE B CONCRETE CURB AND GUTTER				
Type	T ₁ (Inches)	T ₂ (Inches)	Cu. Yd. Per Lin. Ft.	Lin. Ft. Per Cu. Yd.
B66	6	5 ¹ / ₁₆	0.057	17.7
B67	7	6 ¹ / ₁₆	0.065	15.4
B68	8	7 ¹ / ₁₆	0.073	13.7
B68.5	8.5	7 ⁹ / ₁₆	0.077	13.0
B69	9	8 ¹ / ₁₆	0.081	12.3
B69.5	9.5	8 ⁹ / ₁₆	0.085	11.7
B610	10	9 ¹ / ₁₆	0.090	11.2
B610.5	10.5	9 ⁹ / ₁₆	0.094	10.7
B611	11	10 ¹ / ₁₆	0.098	10.2
B611.5	11.5	10 ⁹ / ₁₆	0.102	9.8
B612	12	11 ¹ / ₁₆	0.106	9.4


GENERAL NOTES:

When concrete curb and gutter longitudinally adjoins new concrete pavement, the method of attachment will be by one of the methods shown on standard plate 380.11.

See standard plate 650.90 for expansion and contraction joints in the curb and gutter.

December 23, 2019

Published Date: 1st Qtr. 2023	S D D O T	TYPE B CONCRETE CURB AND GUTTER	PLATE NUMBER 650.01
			Sheet 1 of 1

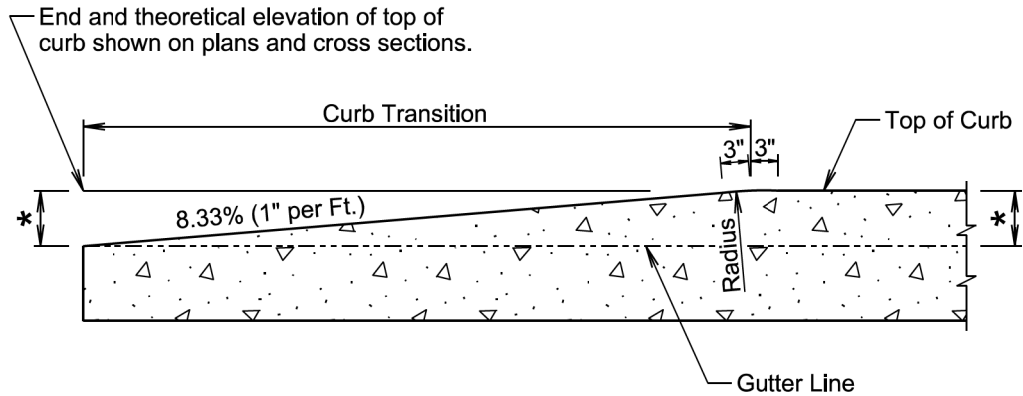


* Height of Curb

LONGITUDINAL SECTION
(Concrete Curb Taper)

December 23, 2019

Published Date: 1st Qtr. 2023	S D D O T	CONCRETE CURB TAPER	PLATE NUMBER 650.35
			Sheet 1 of 1

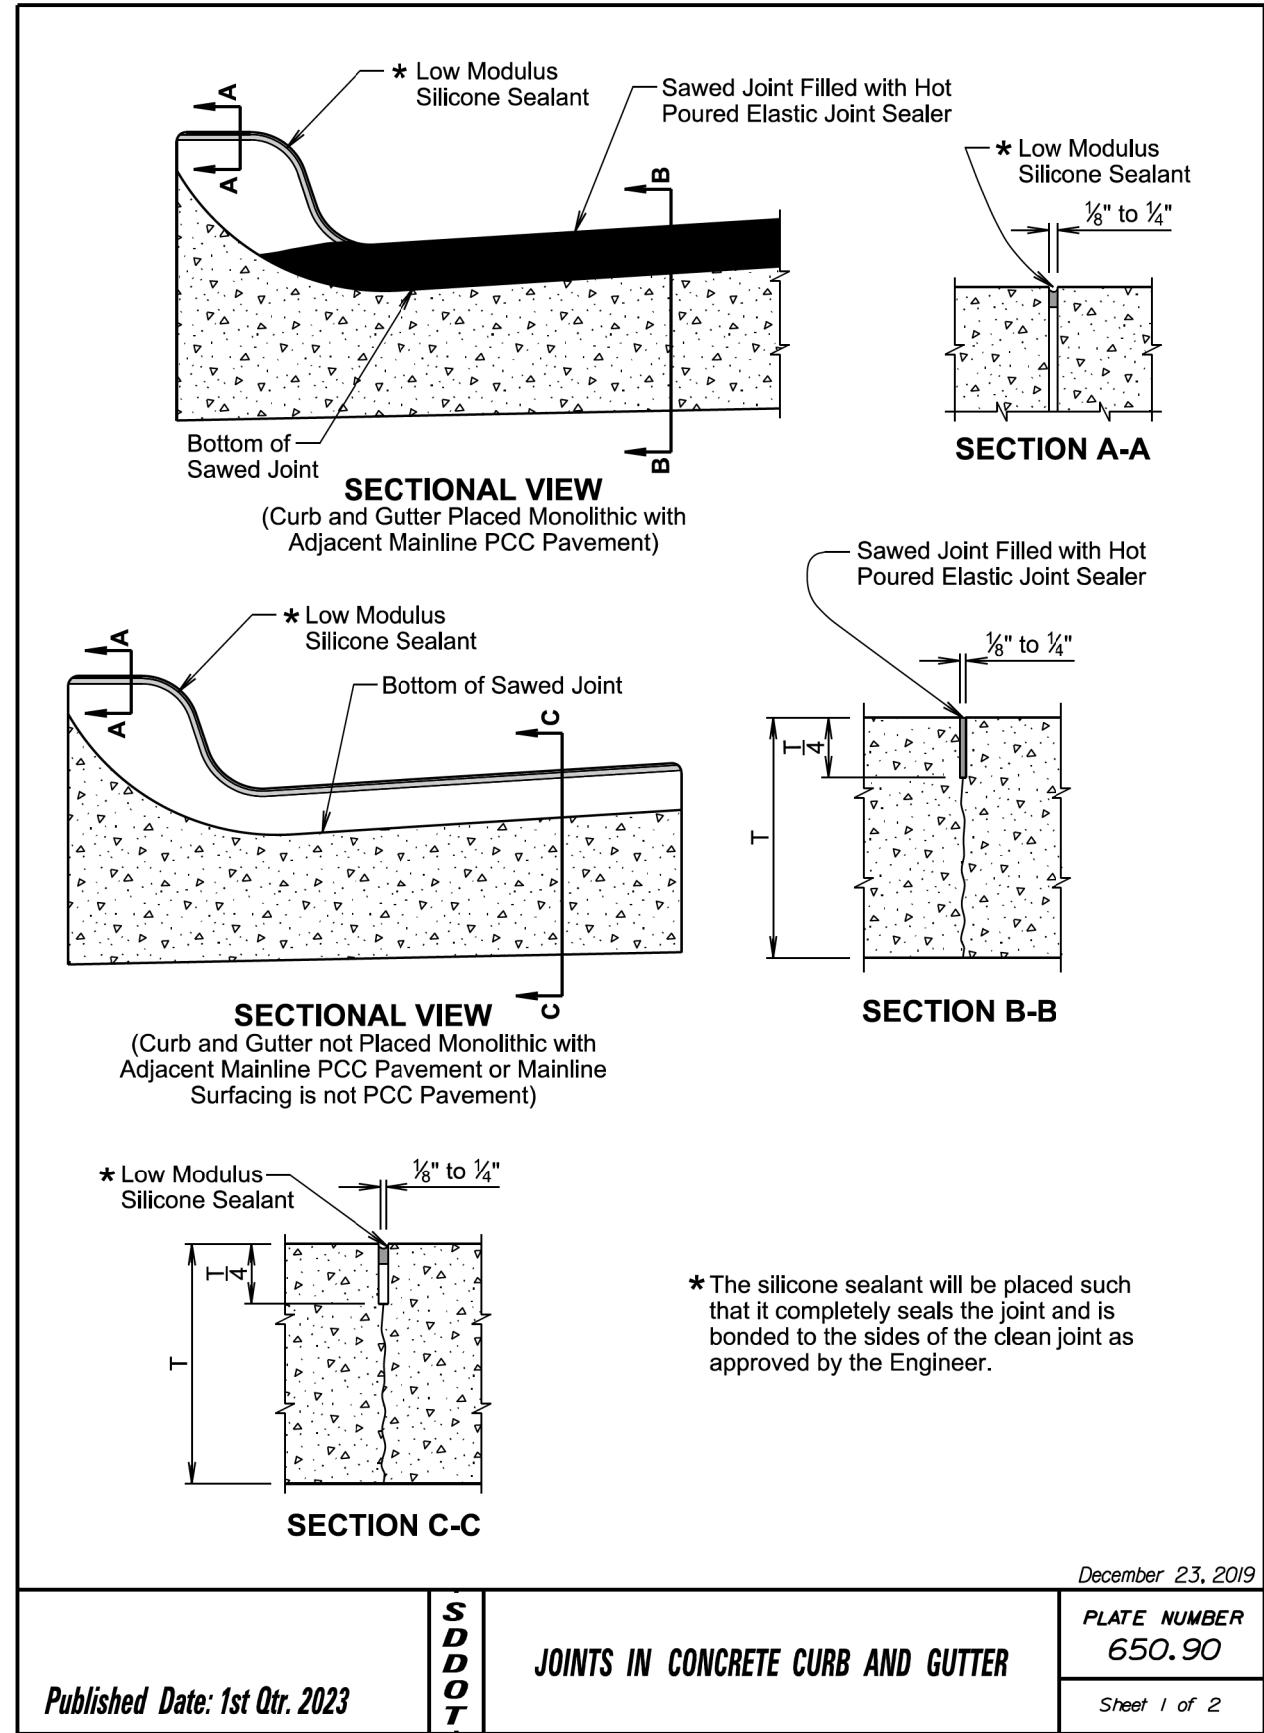

STATE OF SOUTH DAKOTA	PROJECT	SHEET	TOTAL SHEETS
	090 W-451	11	11

Plotting Date: 02/08/2023

